

Strem Kit Manual

96-7520: Iridium/Nickel PhotoRedOx Base and Solvent Screening Kit 1



METALS • INORGANICS • ORGANOMETALLICS • CATALYSTS • LIGANDS • NANOMATERIALS • CUSTOM SYNTHESIS • cGMP FACILITIES

Sold in collaboration with HepatoChem

96-7520 EvoluChem™ Iridium/Nickel PhotoRedOx Base and Solvent Screening Kit 1 1 kit

Product overview:

The EvoluChem™ photochemical kits are ideal tools for the investigation of reaction conditions. This enables you to conveniently screen multiple reaction conditions simultaneously using pre-weighed catalysts and reagents. We offer pre-selected arrays of reagents, catalysts and/or salts or custom arrays depending on your needs.

Benefits

- Facilitates screen of photochemical reaction conditions
- Enables up to 32 reaction conditions simultaneously
- Save substrate using low scale reaction conditions
- Save time on optimization

Recommendations

- Safety personal protection such as gloves, safety glasses and lab coat should be worn at all times.
- Always use a clean and dry syringe to add and transfer solution.

Material required, but not supplied

- Customer supplied substrate
- Customer supplied reaction solvent(s)
- EvoluChem™ PhotoRedOx Box
- EvoluChem™ Light Source 18W-450 nm
- Nitrogen or Argon line for sparging solvents with two needles
- DMSO
- Stirring plate
- Syringe, decapper and reaction block

Storage and Stability

- Store at 2-8°C in dark.
- Stable for 12 months.

Kit Contents

Description	Label	Quantity	Amount
Ir[dF(CF ₃)ppy] ₂ (dtbbpy)[PF ₆] (Strem# 77-0425) / NiCl ₂ -dme / dtbbpy / Cs ₂ CO ₃	Ir/Ni-dtbbpy / Cs ₂ CO ₃	2 x vials	0.1 μmol / 0.5 μmol / 0.5 μmol / 15 μmol
Ir[dF(CF ₃)ppy] ₂ (dtbbpy)[PF ₆] (Strem# 77-0425) / NiCl ₂ -dme / dtbbpy / K ₃ PO ₄	Ir/Ni-dtbbpy / K ₃ PO ₄	2 x vials	0.1 μmol / 0.5 μmol / 0.5 μmol / 15 μmol
Ir[dF(CF ₃)ppy] ₂ (dtbbpy)[PF ₆] (Strem# 77-0425) / NiCl ₂ -dme / dtbbpy / K ₂ HPO ₄	Ir/Ni-dtbbpy / K ₂ HPO ₄	2 x vials	0.1 μmol / 0.5 μmol / 0.5 μmol / 15 μmol
Ir[dF(CF ₃)ppy] ₂ (dtbbpy)[PF ₆] (Strem# 77-0425) / NiCl ₂ -dme / dtbbpy / KOH	Ir/Ni-dtbbpy / KOH	2 x vials	0.1 μmol / 0.5 μmol / 0.5 μmol / 15 μmol
Ir[dF(CF ₃)ppy] ₂ (dtbbpy)[PF ₆] (Strem# 77-0425) / NiCl ₂ -dme / dtbbpy / Li ₂ CO ₃	Ir/Ni-dtbbpy / Li ₂ CO ₃	2 x vials	0.1 μmol / 0.5 μmol / 0.5 μmol / 15 μmol
Ir[dF(CF ₃)ppy] ₂ (dtbbpy)[PF ₆] (Strem# 77-0425) / NiCl ₂ -dme / dtbbpy / K ₂ CO ₃	Ir/Ni-dtbbpy / K ₂ CO ₃	2 x vials	0.1 μmol / 0.5 μmol / 0.5 μmol / 15 μmol
Ir[dF(CF ₃)ppy] ₂ (dtbbpy)[PF ₆] (Strem# 77-0425) / NiCl ₂ -dme / dtbbpy / DABCO	Ir/Ni-dtbbpy / DABCO	2 x vials	0.1 μmol / 0.5 μmol / 0.5 μmol / 15 μmol
Ir[dF(CF ₃)ppy] ₂ (dtbbpy)[PF ₆] (Strem# 77-0425) / NiCl ₂ -dme / dtbbpy / DBU*	Ir/Ni-dtbbpy / DBU	2 x vials	0.1 μmol / 0.5 μmol / 0.5 μmol / ---
DBU	DBU	2 x vials	15 μmol

*DBU is added later. See protocol.

Visit www.strem.com for new product information and a searchable catalog.

Strem Chemicals, Inc.
7 Mulliken Way
Newburyport, MA 01950
U.S.A.
Tel: 978.499.1600
Fax: 978.465.3104
Email: info@strem.com

Strem Chemicals, Inc.
15, rue de l'Atome
Zone Industrielle
67800 BISCHHEIM France
Tel: (33) 03 88 62 52 60
Fax: (33) 03 88 62 26 81
Email: info.europe@strem.com

Strem Chemicals, Inc.
Postfach 1215
77672 KEHL
Germany
Tel: 0 78 51/ 7 58 79
Email: info.europe@strem.com

Strem Chemicals UK Ltd.
An Independent Distributor of Strem Chemicals Products
Newton Hall, Town Street
Newton, Cambridge
England CB22 7ZE
Tel: +44 (0)1223 873 028
Fax: +44 (0)1223 870207
Email: enquiries@strem.co.uk

Reagent Information			
Strem Item#	Vial	CAS	MW
77-0425	Ir[dF(CF ₃)ppy] ₂ (dtbbpy)][PF ₆]	870987-63-6	1121.91
93-2801	NiCl ₂ -dme	29046-78-4	219.72
07-0273	4,4'-Bis(di-t-butyl)-2,2'-bipyridine(dtbbpy)	72914-19-3	268.40
93-5514	Cesium carbonate	534-17-8	325.82
19-3800	Potassium phosphate tribasic	7778-53-2	212.27
93-1940	Potassium phosphate dibasic	7758-11-4	174.20
19-3150	Potassium hydroxide	1310-58-3	56.11
93-0311	Lithium carbonate	554-13-2	73.89
93-1912	Potassium carbonate	584-08-7	138.20
N/A	1,4-diazabicyclo[2.2.2]octane (DABCO)	280-57-9	112.17
N/A	1,8-Diazabicyclo[5.4.0]undec-7-ene (DBU)	6674-22-2	152.24

Typical Protocol

- The typical protocol is performed at 0.05 mol/l using a solution containing two coupling components. Each sealed reaction vial contains 0.1 μmol of photocatalyst, 0.5 μmol Ni catalyst, 0.5 μmol ligand and 15 of μmol base (for all bases except for DBU conditions, base is added separately and shipped in a separate vial).
- Based on the concentration of the substrates stock solution and the volume added, the following reaction stoichiometry can be achieved with the standard Ir/Ni photoredox kit. See table below.

Conc. [M]	Vol. (μl)	Equiv. Ir Cat.	Equiv. Ni Cat	Equiv. base
0.050	100	0.02	0.10	3.0
0.050	200	0.01	0.05	1.5
0.025	200	0.02	0.10	3.0
0.025	100	0.04	0.20	6.0

- Should solubility of substrate be an issue, lower concentrations can be used although longer reaction times may be required.
- The Ir/Ni photoredox kit contains 2 sets of vials allowing the screening of two different solvents. Recommended solvents include but are not limited to acetonitrile, dimethylformamide, dimethylacetamide, dimethylsulfoxide.
- Sparging reaction solvents with nitrogen or argon while transferring reagents is important to achieve highest conversions of product. See protocol diagram for instructions.

Protocol at 100 μl volume reaction condition

- Prepare the required volume of substrate solution at 0.05 mol/L containing both coupling substrates. For example, 900 μl solution for 8 reaction conditions (100 μl extra to compensate potential evaporation).
- Degas substrate solution with subsurface sparging via N₂ or Ar line with exit needle for 5 minutes.
- Using a clean and dry syringe, add 100 μl of the substrate solution to each reaction vial (excluding DBU for now).
- Add 100 ul of substrate solution to vial containing DBU base vial. Repeat degas of solution.
- Add full contents to remaining DBU reaction vial.
- Repeat steps 2 and 5 for each substrate solvent mixture.
- Stir the reaction vials for 5 minutes prior to turning on the light to allow catalysts to fully dissolve (some bases will remain insoluble). The card containing the vials can be placed directly on the opening of the photochemistry device.
- Turn on lamp and stir vials for 18 to 24 hours (or longer if necessary). Be sure to plug in fan to maintain RT.
- Upon completion of reaction, remove the vial caps using a decapper.
- Prepare analytical sample for each reaction condition with 5 μl sample diluted into 200 μl in either DMSO or water/acetonitrile 50/50. Alternatively, reaction solvent can be evaporated *in vacuo* and crude mixture diluted in water/acetonitrile prior to preparation of analytical sample.
- Analyze resulting analytical samples by LC/MS.

Visit www.strem.com for new product information and a searchable catalog.


Strem Chemicals, Inc.
7 Mulliken Way
Newburyport, MA 01950
U.S.A
Tel: 978.499.1600
Fax: 978.465.3104
Email: info@strem.com

Strem Chemicals, Inc.
15, rue de l'Atome
Zone Industrielle
67800 BISCHHEIM France
Tel: (33) 03 88 62 52 60
Fax: (33) 03 88 62 26 81
Email: info.europe@strem.com

Strem Chemicals, Inc.
Postfach 1215
77672 KEHL
Germany
Tel: 0 78 51/ 7 58 79
Email: info.europe@strem.com

Strem Chemicals UK Ltd.
An Independent Distributor of Strem Chemicals Products
Newton Hall, Town Street
Newton, Cambridge
England CB22 7ZE
Tel: +44 (0)1223 873 028
Fax: +44 (0)1223 870207
Email: enquiries@strem.co.uk

Protocol Diagram

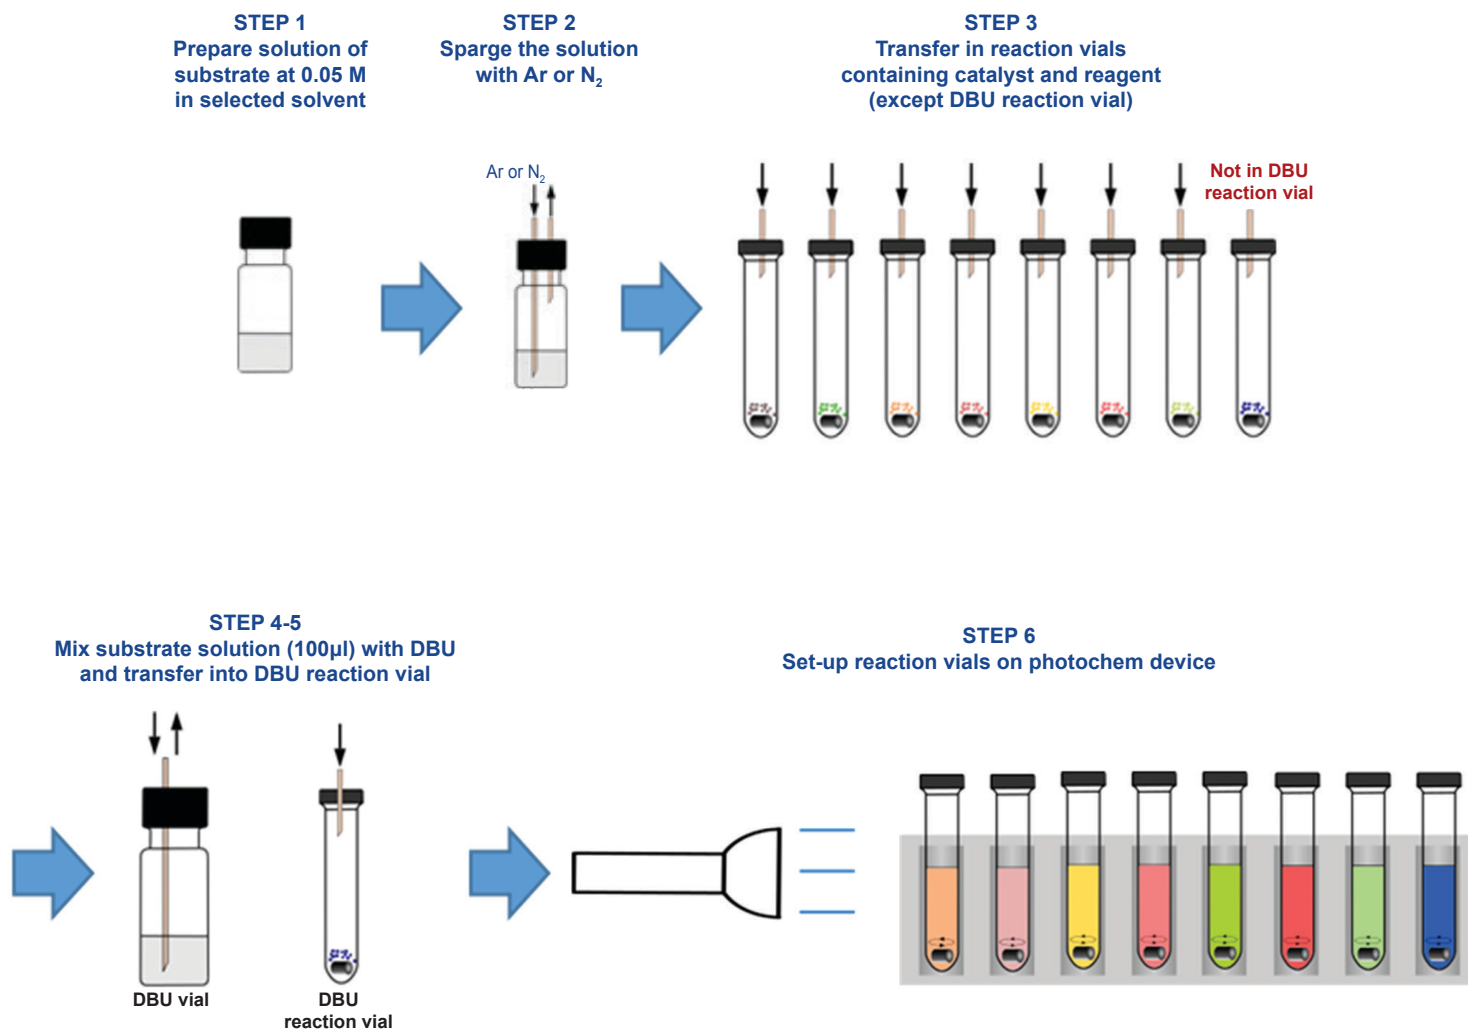

Visit www.strem.com for new product information and a searchable catalog.

Strem Chemicals, Inc.
7 Mulliken Way
Newburyport, MA 01950
U.S.A
Tel: 978.499.1600
Fax: 978.465.3104
Email: info@strem.com

Strem Chemicals, Inc.
15, rue de l'Atome
Zone Industrielle
67800 BISCHEIM France
Tel: (33) 03 88 62 52 60
Fax: (33) 03 88 62 26 81
Email: info.europe@strem.com

Strem Chemicals, Inc.
Postfach 1215
77672 KEHL
Germany
Tel: 0 78 51/ 7 58 79
Email: info.europe@strem.com

Strem Chemicals UK Ltd.
An Independent Distributor of Strem Chemicals Products
Newton Hall, Town Street
Newton, Cambridge
England CB22 7ZE
Tel: +44 (0)1223 873 028
Fax: +44 (0)1223 870207
Email: enquiries@strem.co.uk

Visit www.strem.com for new product information and a searchable catalog.

Strem Chemicals, Inc.
7 Mulliken Way
Newburyport, MA 01950
U.S.A
Tel: 978.499.1600
Fax: 978.465.3104
Email: info@strem.com

Strem Chemicals, Inc.
15, rue de l'Atome
Zone Industrielle
67800 BISCHHEIM France
Tel: (33) 03 88 62 52 60
Fax: (33) 03 88 62 26 81
Email: info.europe@strem.com

Strem Chemicals, Inc.
Postfach 1215
77672 KEHL
Germany
Tel: 0 78 51/ 7 58 79
Email: info.europe@strem.com

Strem Chemicals UK Ltd.
An Independent Distributor of Strem Chemicals Products
Newton Hall, Town Street
Newton, Cambridge
England CB22 7ZE
Tel: +44 (0)1223 873 028
Fax: +44 (0)1223 870207
Email: enquiries@strem.co.uk